


A1

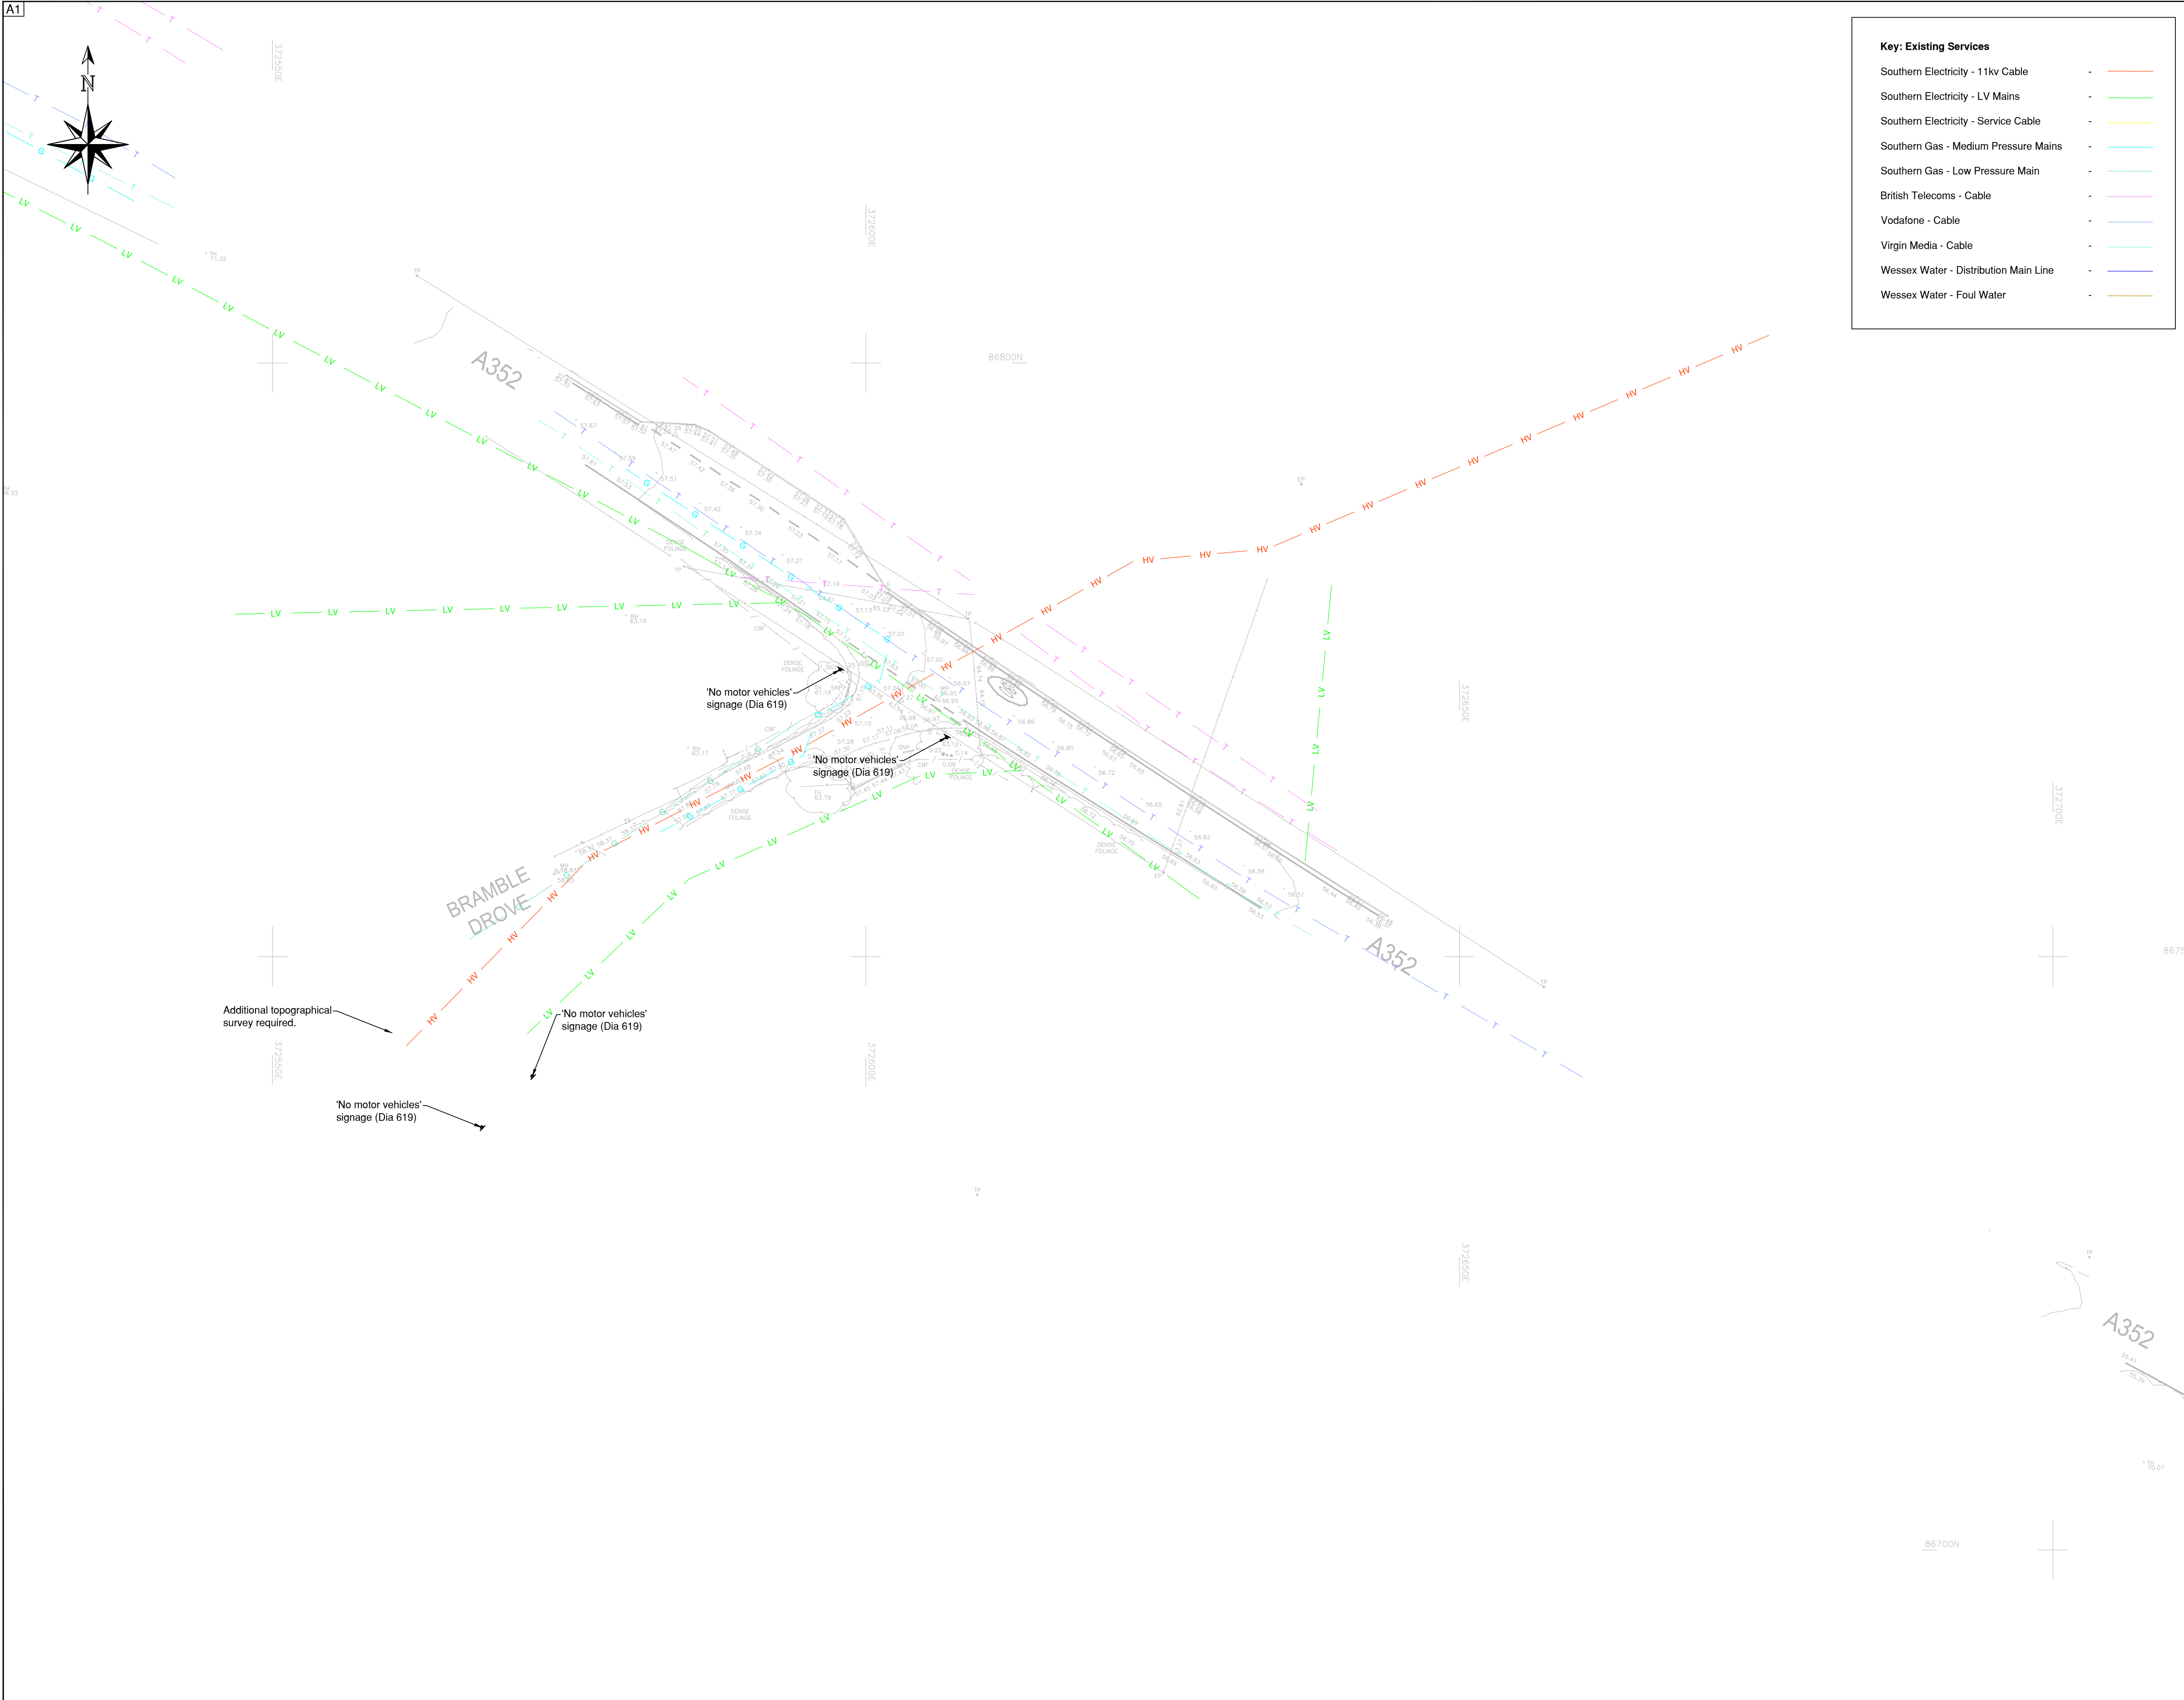

Key: Existing Services

- Southern Electricity - 11kv Cable
- Southern Electricity - LV Mains
- Southern Electricity - Service Cable
- Southern Gas - Medium Pressure Mains
- Southern Gas - Low Pressure Main
- British Telecoms - Cable
- Vodafone - Cable
- Virgin Media - Cable
- Wessex Water - Distribution Main Line
- Wessex Water - Foul Water

GENERAL NOTES

- DO NOT SCALE.
- This drawing is to be read in conjunction with all other relevant drawings and details.
- Should there be any conflict between the details indicated on this drawing and those on other drawings the Engineer should be informed PRIOR to construction on site.
- Until technical approval has been obtained from the relevant Authority, it should be understood that all drawings issued are Preliminary and NOT for construction. Should the Contractor commence site works prior to such approval being provided it is entirely at their own risk.
- All dimensions are in metres unless otherwise stated.
- The Rodgers Leask Designer's Risk Assessment(s) for this project must be reviewed PRIOR to the commencement of any works on site.
- This drawing should be read in conjunction with Section 278 Agreement Works Key Plan 24592-RL-24-XX-DR-C-1005.
- This drawing is intended to illustrate the extent of S278 works proposed only and does not purport to be a detailed design.

Legend

- Site Boundary
- Assumed existing of public highway
- P1 - Full depth Carriageway
- P2 - Plane and Overlay Carriageway
- F1 - Full Depth Footway
- V1 - Grass Verge
- Features to be relocated or reconstructed
- Tactile Paving Array
- Proposed Kerbline

Health and safety symbols refer to reference numbers indicated on Designers Risk Assessment number: 24592-RL-24-XX-HS-C-0001

Health & Safety Information Key

- Used to provide design specific safety information that may not be obvious to a competent contractor but may be useful
- Used to restrict/prevent a possible action, e.g. stop construction traffic from entering an area
- Used to warn of significant design hazards, adding recommendations
- Used to encourage a positive action, e.g. use of robust protection for inspection chambers

P01	23.12.24	First Issue	DP	CB
Rev	Date	Amendments	By	Chk



Client
Abri Group

Project
Land adjacent Broadmead Broadmayne, Dorset

Drawing Title
Zone 6 General Arrangement Improvements to Bramble Drove

Status
For Information

Scale	Drawn	Checked	Date
A1 @ 1:250	DP	CB	23.12.24



Drawing Number	Revision
24592-RL-24-XX-DR-C-1060	P01

BIM Drawing Reference
-

Scale Bar
1:250

Copyright © Rodgers Leask Limited

1/12004 • Woodlands Court • Ash Ridge Road • Alfordbury • Shropshire • BS29 4LB • Tel: 01456 878411 • www.rodgersleask.co.uk

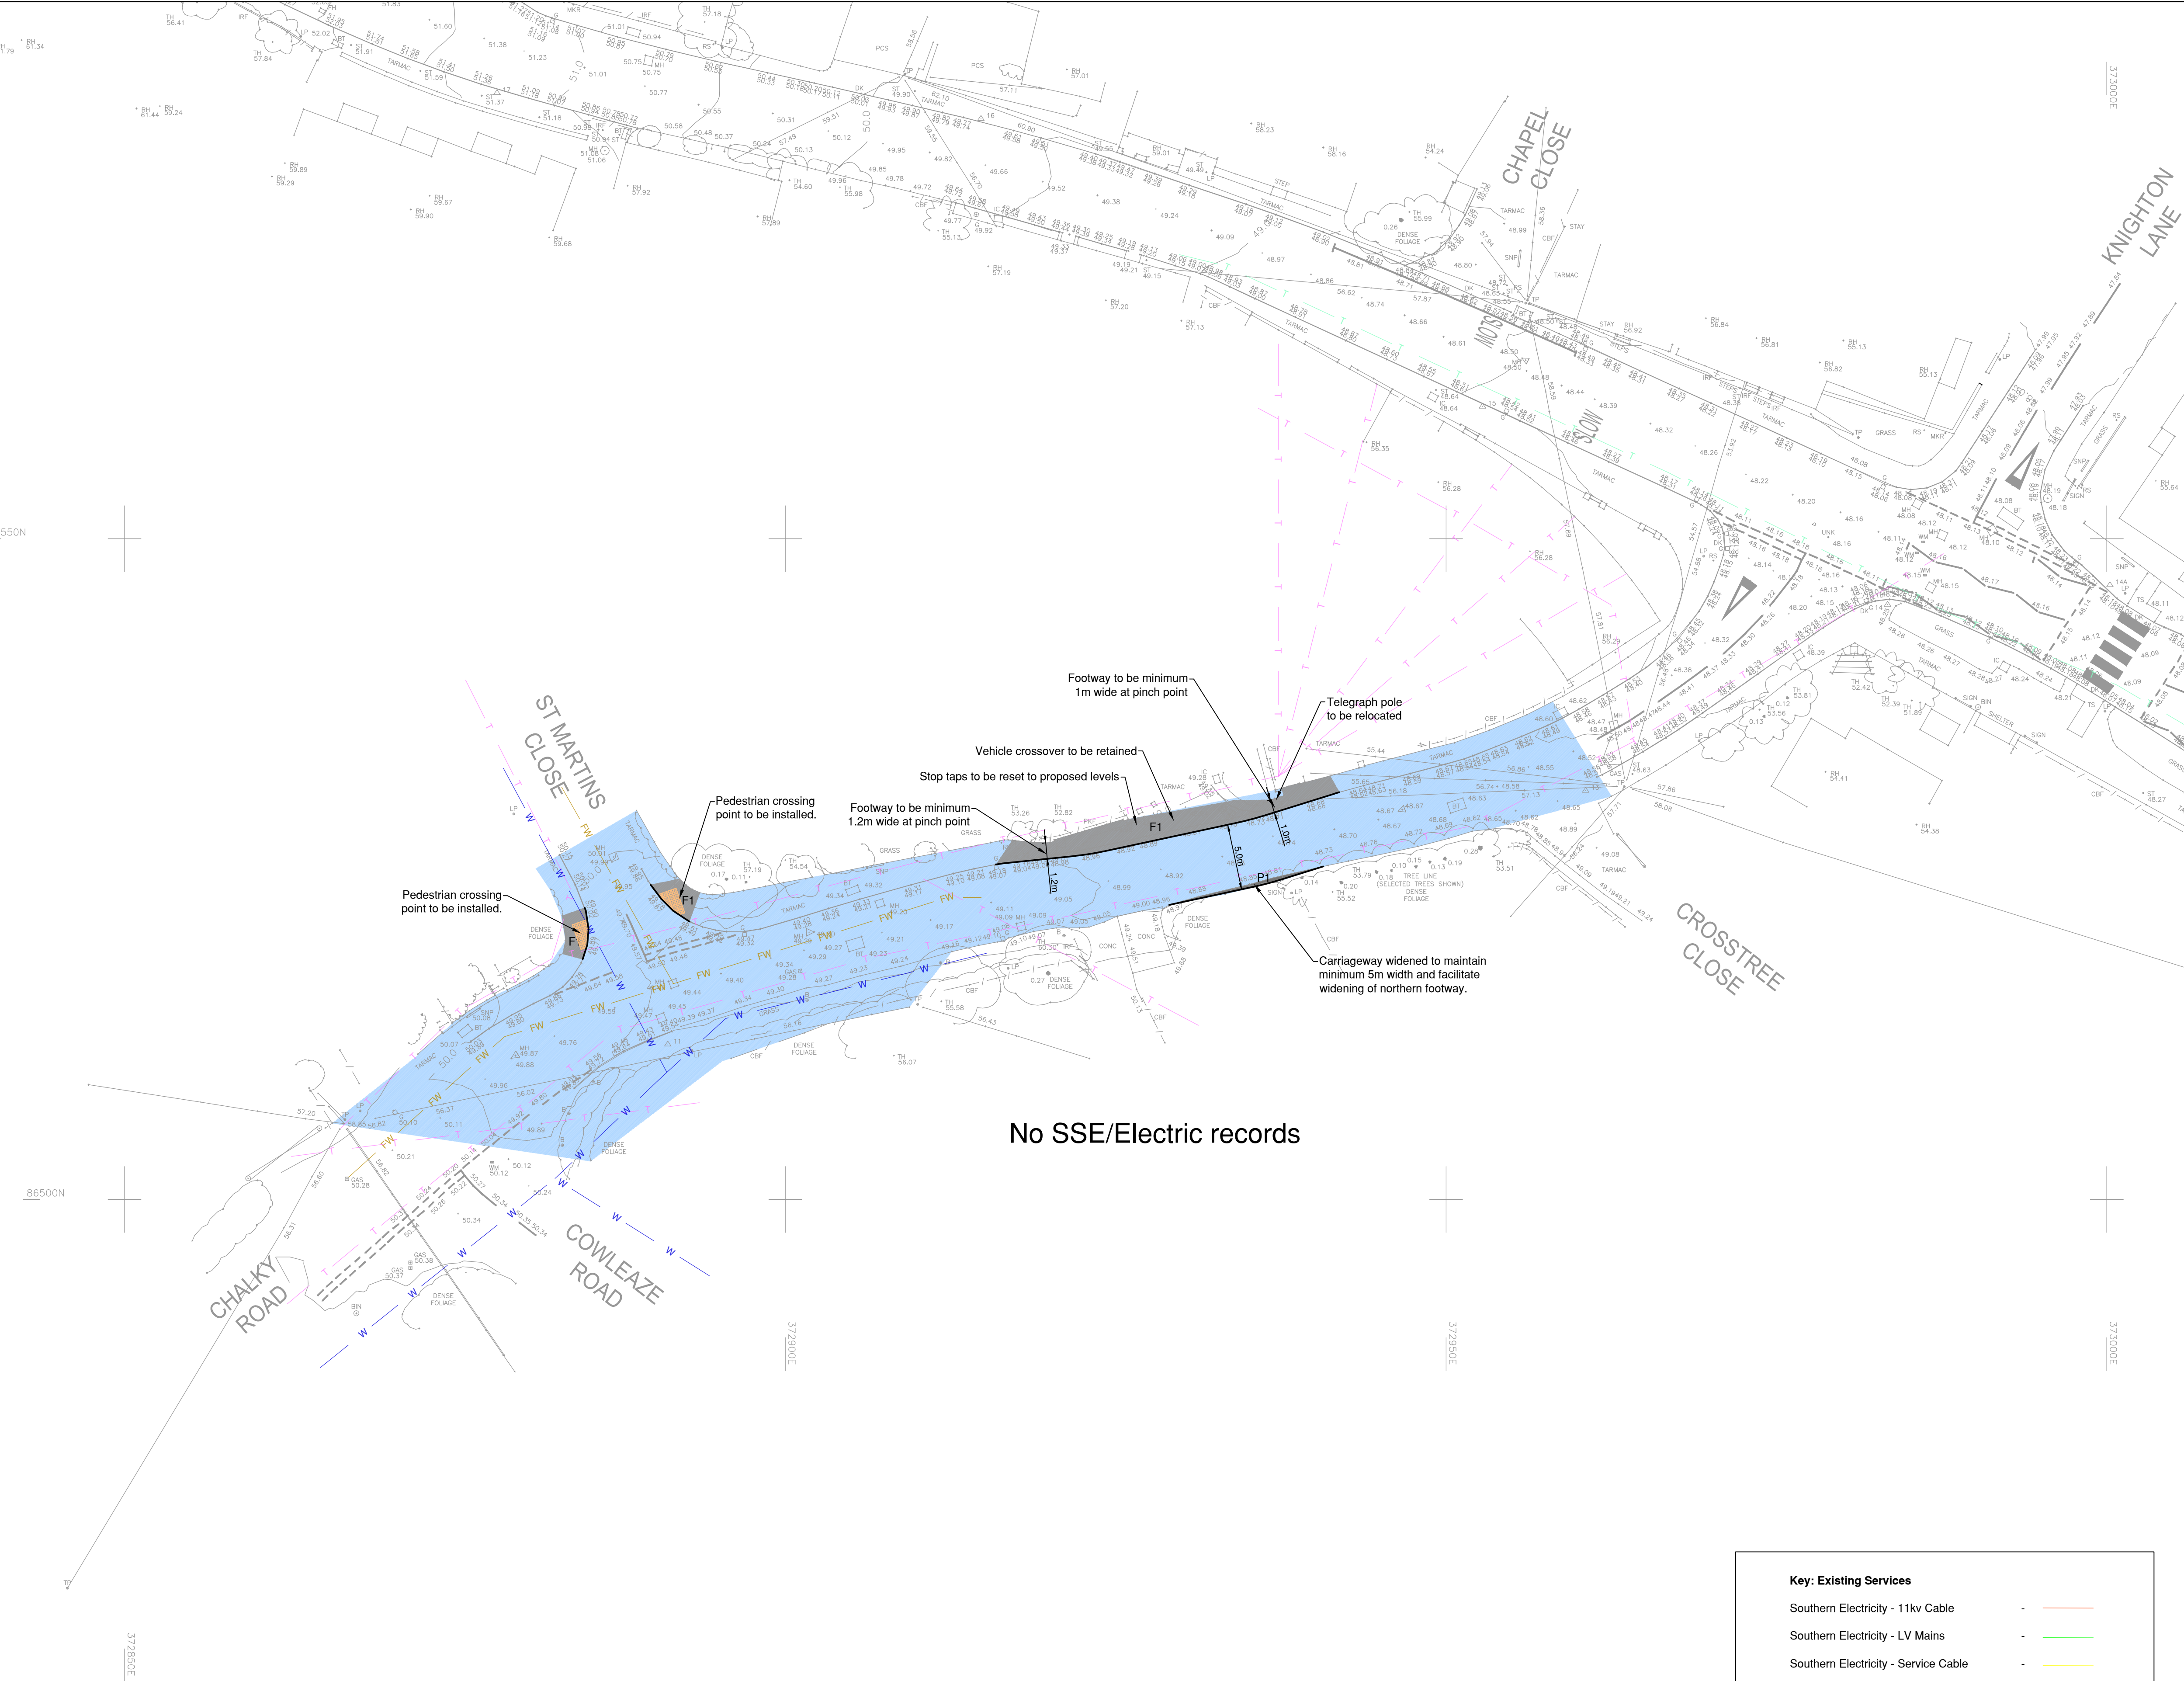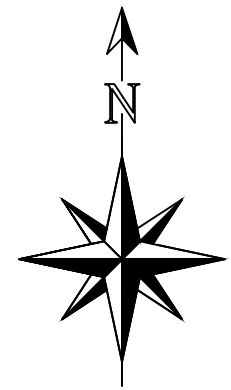

- GENERAL NOTES**
1. DO NOT SCALE.
 2. This drawing is to be read in conjunction with all other relevant drawings and details.
 3. Should there be any conflict between the details indicated on this drawing and those on other drawings the Engineer should be informed PRIOR to construction on site.
 4. Until technical approval has been obtained from the relevant Authority, it should be understood that all drawings issued are Preliminary and NOT for construction. Should the Contractor commence site works prior to such approval being provided it is entirely at their own risk.
 5. All dimensions are in metres unless otherwise stated.
 6. The Rodgers Leask Designer's Risk Assessment(s) for this project must be reviewed PRIOR to the commencement of any works on site.
 7. This drawing should be read in conjunction with Section 278 Agreement Works Key Plan 24592-RLL-24-XX-DR-C-1005.
 8. This drawing is intended to illustrate the extent of S278 works proposed only and does not purport to be a detailed design.

- Legend**
- Site Boundary
 - Assumed existing of public highway
 - P1 - Full depth Carriageway
 - P2 - Plane and Overlay Carriageway
 - F1 - Full Depth Footway
 - V1 - Grass Verge
 - Features to be relocated or reconstructed
 - Tactile Paving Array
 - Proposed Kerbline

Health and safety symbols refer to reference numbers indicated on Designers Risk Assessment number: 24592-RLL-24-XX-HS-C-0001

- Health & Safety Information Key**
- Used to provide design specific safety information that may not be obvious to a competent contractor but may be useful
 - Used to restrict/prevent a possible action, e.g. stop construction traffic from entering an area
 - Used to warn of significant design hazards, adding recommendations
 - Used to encourage a positive action, e.g. use of robust protection for inspection chambers

P01	23.12.24	First Issue	DP	CB
Rev	Date	Amendments	By	Chk



Client
Abri Group

Project
Land adjacent Broadmead Broadmayne, Dorset


Drawing Title
Zone 4 General Arrangement Improvements to Chalky Road Footway

Status
For Information


Scale
A1 @ 1:250

Drawing Number
24592-RLL-24-XX-DR-C-1040

BIM Drawing Reference
-

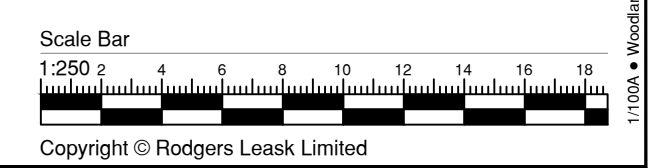

- Key: Existing Services**
- Southern Electricity - 11kv Cable
 - Southern Electricity - LV Mains
 - Southern Electricity - Service Cable
 - Southern Gas - Medium Pressure Mains
 - Southern Gas - Low Pressure Main
 - British Telecoms - Cable
 - Vodafone - Cable
 - Virgin Media - Cable
 - Wessex Water - Distribution Main Line
 - Wessex Water - Foul Water

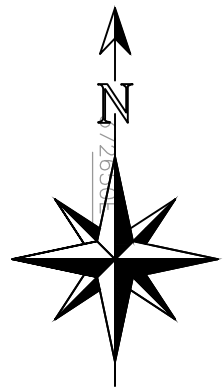

Key: Existing Services		
Southern Electricity - 11kv Cable	-	
Southern Electricity - LV Mains	-	
Southern Electricity - Service Cable	-	
Southern Gas - Medium Pressure Mains	-	
Southern Gas - Low Pressure Main	-	
British Telecoms - Cable	-	
Vodafone - Cable	-	
Virgin Media - Cable	-	
Wessex Water - Distribution Main Line	-	
Wessex Water - Foul Water	-	

GENERAL NOTES	
1. DO NOT SCALE.	
2. This drawing is to be read in conjunction with all other relevant drawings and details.	
3. Should there be any conflict between the details indicated on this drawing and those on other drawings the Engineer should be informed PRIOR to construction on site.	
4. Until technical approval has been obtained from the relevant Authority, it should be understood that all drawings issued are Preliminary and NOT for construction. Should the Contractor commence site works prior to such approval being provided it is entirely at their own risk.	
5. All dimensions are in metres unless otherwise stated.	
6. The Rodgers Leask Designer's Risk Assessment(s) for this project must be reviewed PRIOR to the commencement of any works on site.	
7. This drawing should be read in conjunction with Section 278 Agreement Works Key Plan 24592-RL-24-XX-DR-C-1005.	
8. This drawing is intended to illustrate the extent of S278 works proposed only and does not purport to be a detailed design.	
Legend	
	Site Boundary
	Assumed existing of public highway
	P1 - Full depth Carriageway
	P2 - Plane and Overlay Carriageway
	F1 - Full Depth Footway
	V1 - Grass Verge
	Features to be relocated or reconstructed
	Tactile Paving Array
	Proposed Kerblines

No entry for vehicular traffic (Dia 616)

Build-out to narrow carriageway to 3.7m

V1

3.7m

No left turn signage for vehicles from Conway Drive (Dia 613)

No Wessex Water records (Water/Wastewater)


Health and safety symbols refer to reference numbers indicated on Designers Risk Assessment number: 24592-RL-24-XX-HS-C-0001

Health & Safety Information Key	
	Used to provide design specific safety information that may not be obvious to a competent contractor but may be useful
	Used to restrict/prevent a possible action, e.g. stop construction traffic from entering an area
	Used to warn of significant design hazards, adding recommendations
	Used to encourage a positive action, e.g. use of robust protection for inspection chambers

P01	23.12.24	First Issue	DP	CB
Rev	Date	Amendments	By	Chk



Abri Group			
Project			
Land and adjacent Broadmead Broadmayne, Dorset			
Drawing Title			
Zone 5 General Arrangement Improvements to Conway Drive/ Rectory Road Junction			
Status			
For Information			
Scale	Drawn	Checked	Date
@ 1:250	DP	CB	23.12.24
Drawing Number		Revision	
4592-RLL-24-XX-DR-C-1050		P01	
BIM Drawing Reference			
Scale Bar			
Copyright © Rodgers Leask Limited			

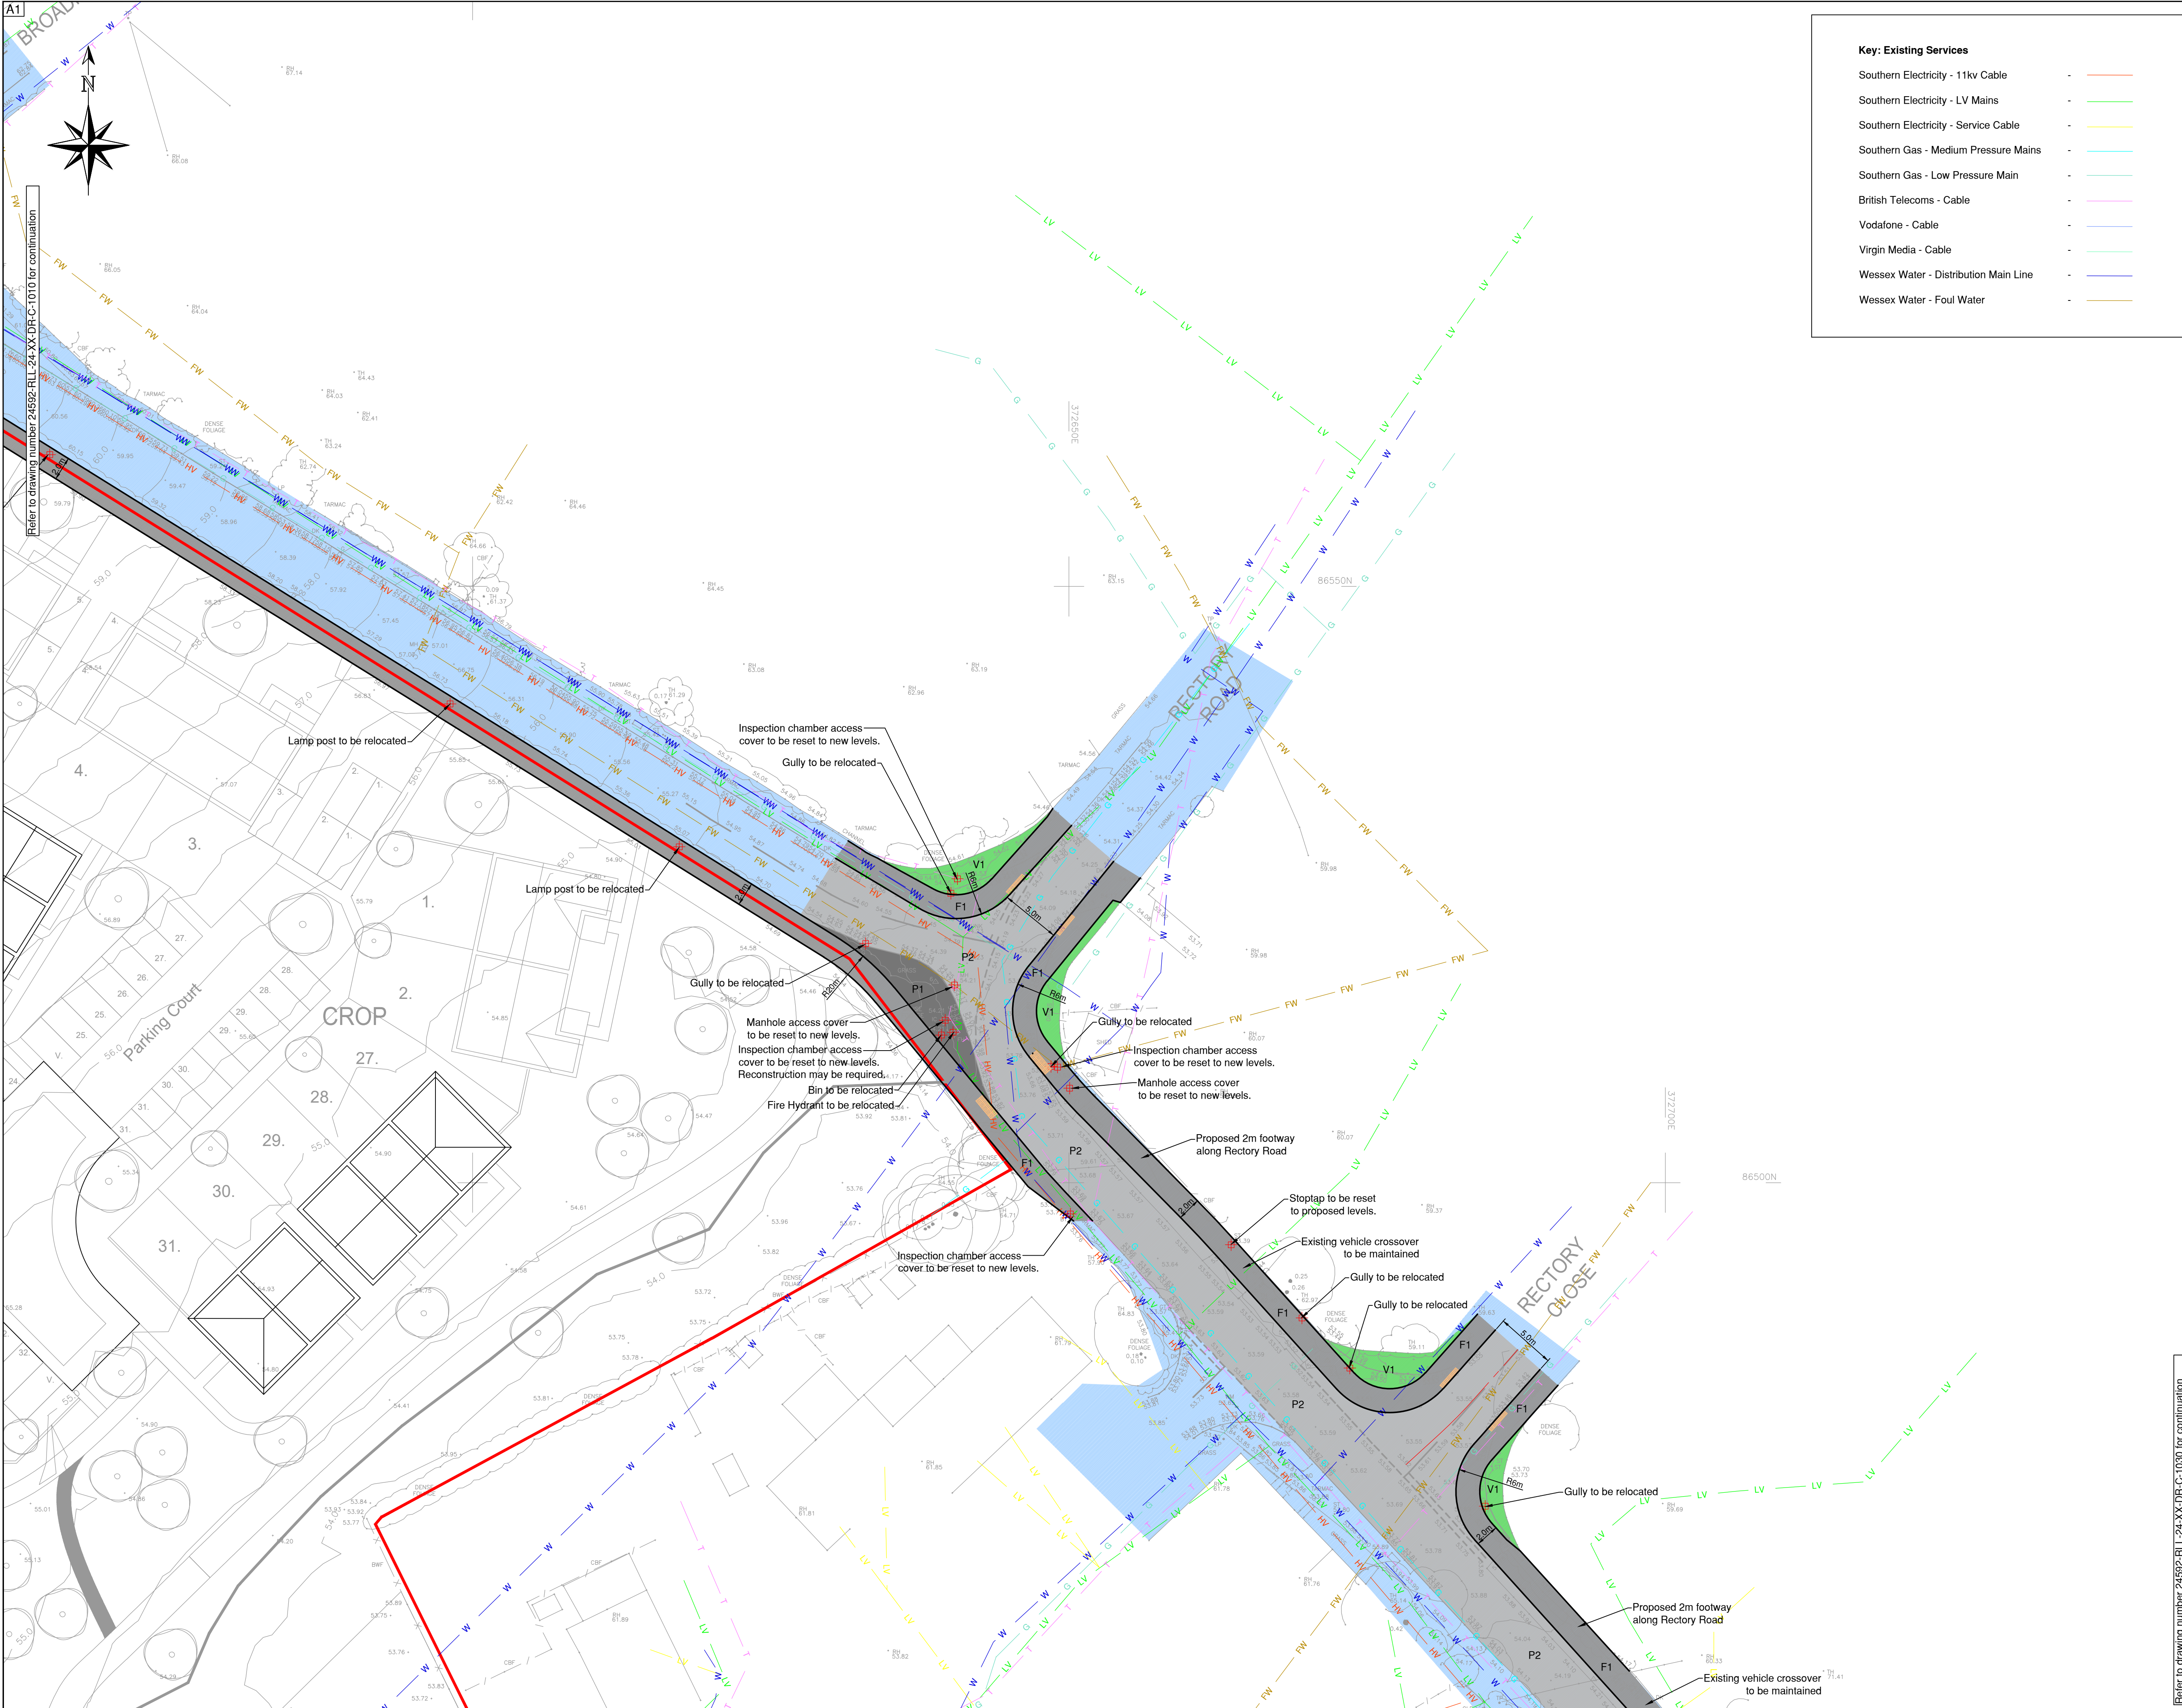

Key: Existing Services

- Southern Electricity - 11kv Cable
- Southern Electricity - LV Mains
- Southern Electricity - Service Cable
- Southern Gas - Medium Pressure Mains
- Southern Gas - Low Pressure Main
- British Telecoms - Cable
- Vodafone - Cable
- Virgin Media - Cable
- Wessex Water - Distribution Main Line
- Wessex Water - Foul Water

GENERAL NOTES

- DO NOT SCALE.
- This drawing is to be read in conjunction with all other relevant drawings and details.
- Should there be any conflict between the details indicated on this drawing and those on other drawings the Engineer should be informed PRIOR to construction on site.
- Until technical approval has been obtained from the relevant Authority, it should be understood that all drawings issued are Preliminary and NOT for construction. Should the Contractor commence site works prior to such approval being provided it is entirely at their own risk.
- All dimensions are in metres unless otherwise stated.
- The Rodgers Leask Designer's Risk Assessment(s) for this project must be reviewed PRIOR to the commencement of any works on site.
- This drawing should be read in conjunction with Section 278 Agreement Works Key Plan 24592-RL-24-XX-DR-C-1005.
- This drawing is intended to illustrate the extent of S278 works proposed only and does not purport to be a detailed design.

Legend

- Site Boundary
- Assumed existing of public highway
- P1 - Full depth Carriageway
- P2 - Plane and Overlay Carriageway
- F1 - Full Depth Footway
- V1 - Grass Verge
- Features to be relocated or reconstructed
- Tactile Paving Array
- Proposed Kerbline

Health and safety symbols refer to reference numbers indicated on Designers Risk Assessment number: 24592-RL-24-XX-HS-C-0001

Health & Safety Information Key

- Used to provide design specific safety information that may not be obvious to a competent contractor but may be useful
- Used to restrict/prevent a possible action, e.g. stop construction traffic from entering an area
- Used to warn of significant design hazards, adding recommendations
- Used to encourage a positive action, e.g. use of robust protection for inspection chambers

P01	23.12.24	First Issue	DP	CB
Rev	Date	Amendments	By	Chk



Client
Abri Group

Project
**Land adjacent Broadmead
Broadmayne, Dorset**


Drawing Title
**Zone 2 General Arrangement
Improvements to Rectory Road/
Chalky Road Junction**

Status
For Information


Scale	Drawn	Checked	Date
A1 @ 1:250	DP	CB	23.12.24

Drawing Number	Revision
24592-RL-24-XX-DR-C-1020	P01

BIM Drawing Reference
-

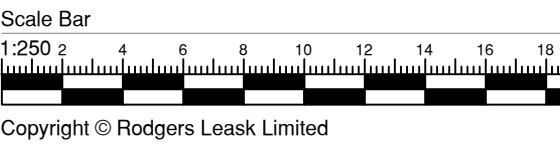

Refer to drawing number 24592-RL-24-XX-DR-C-1030 for continuation

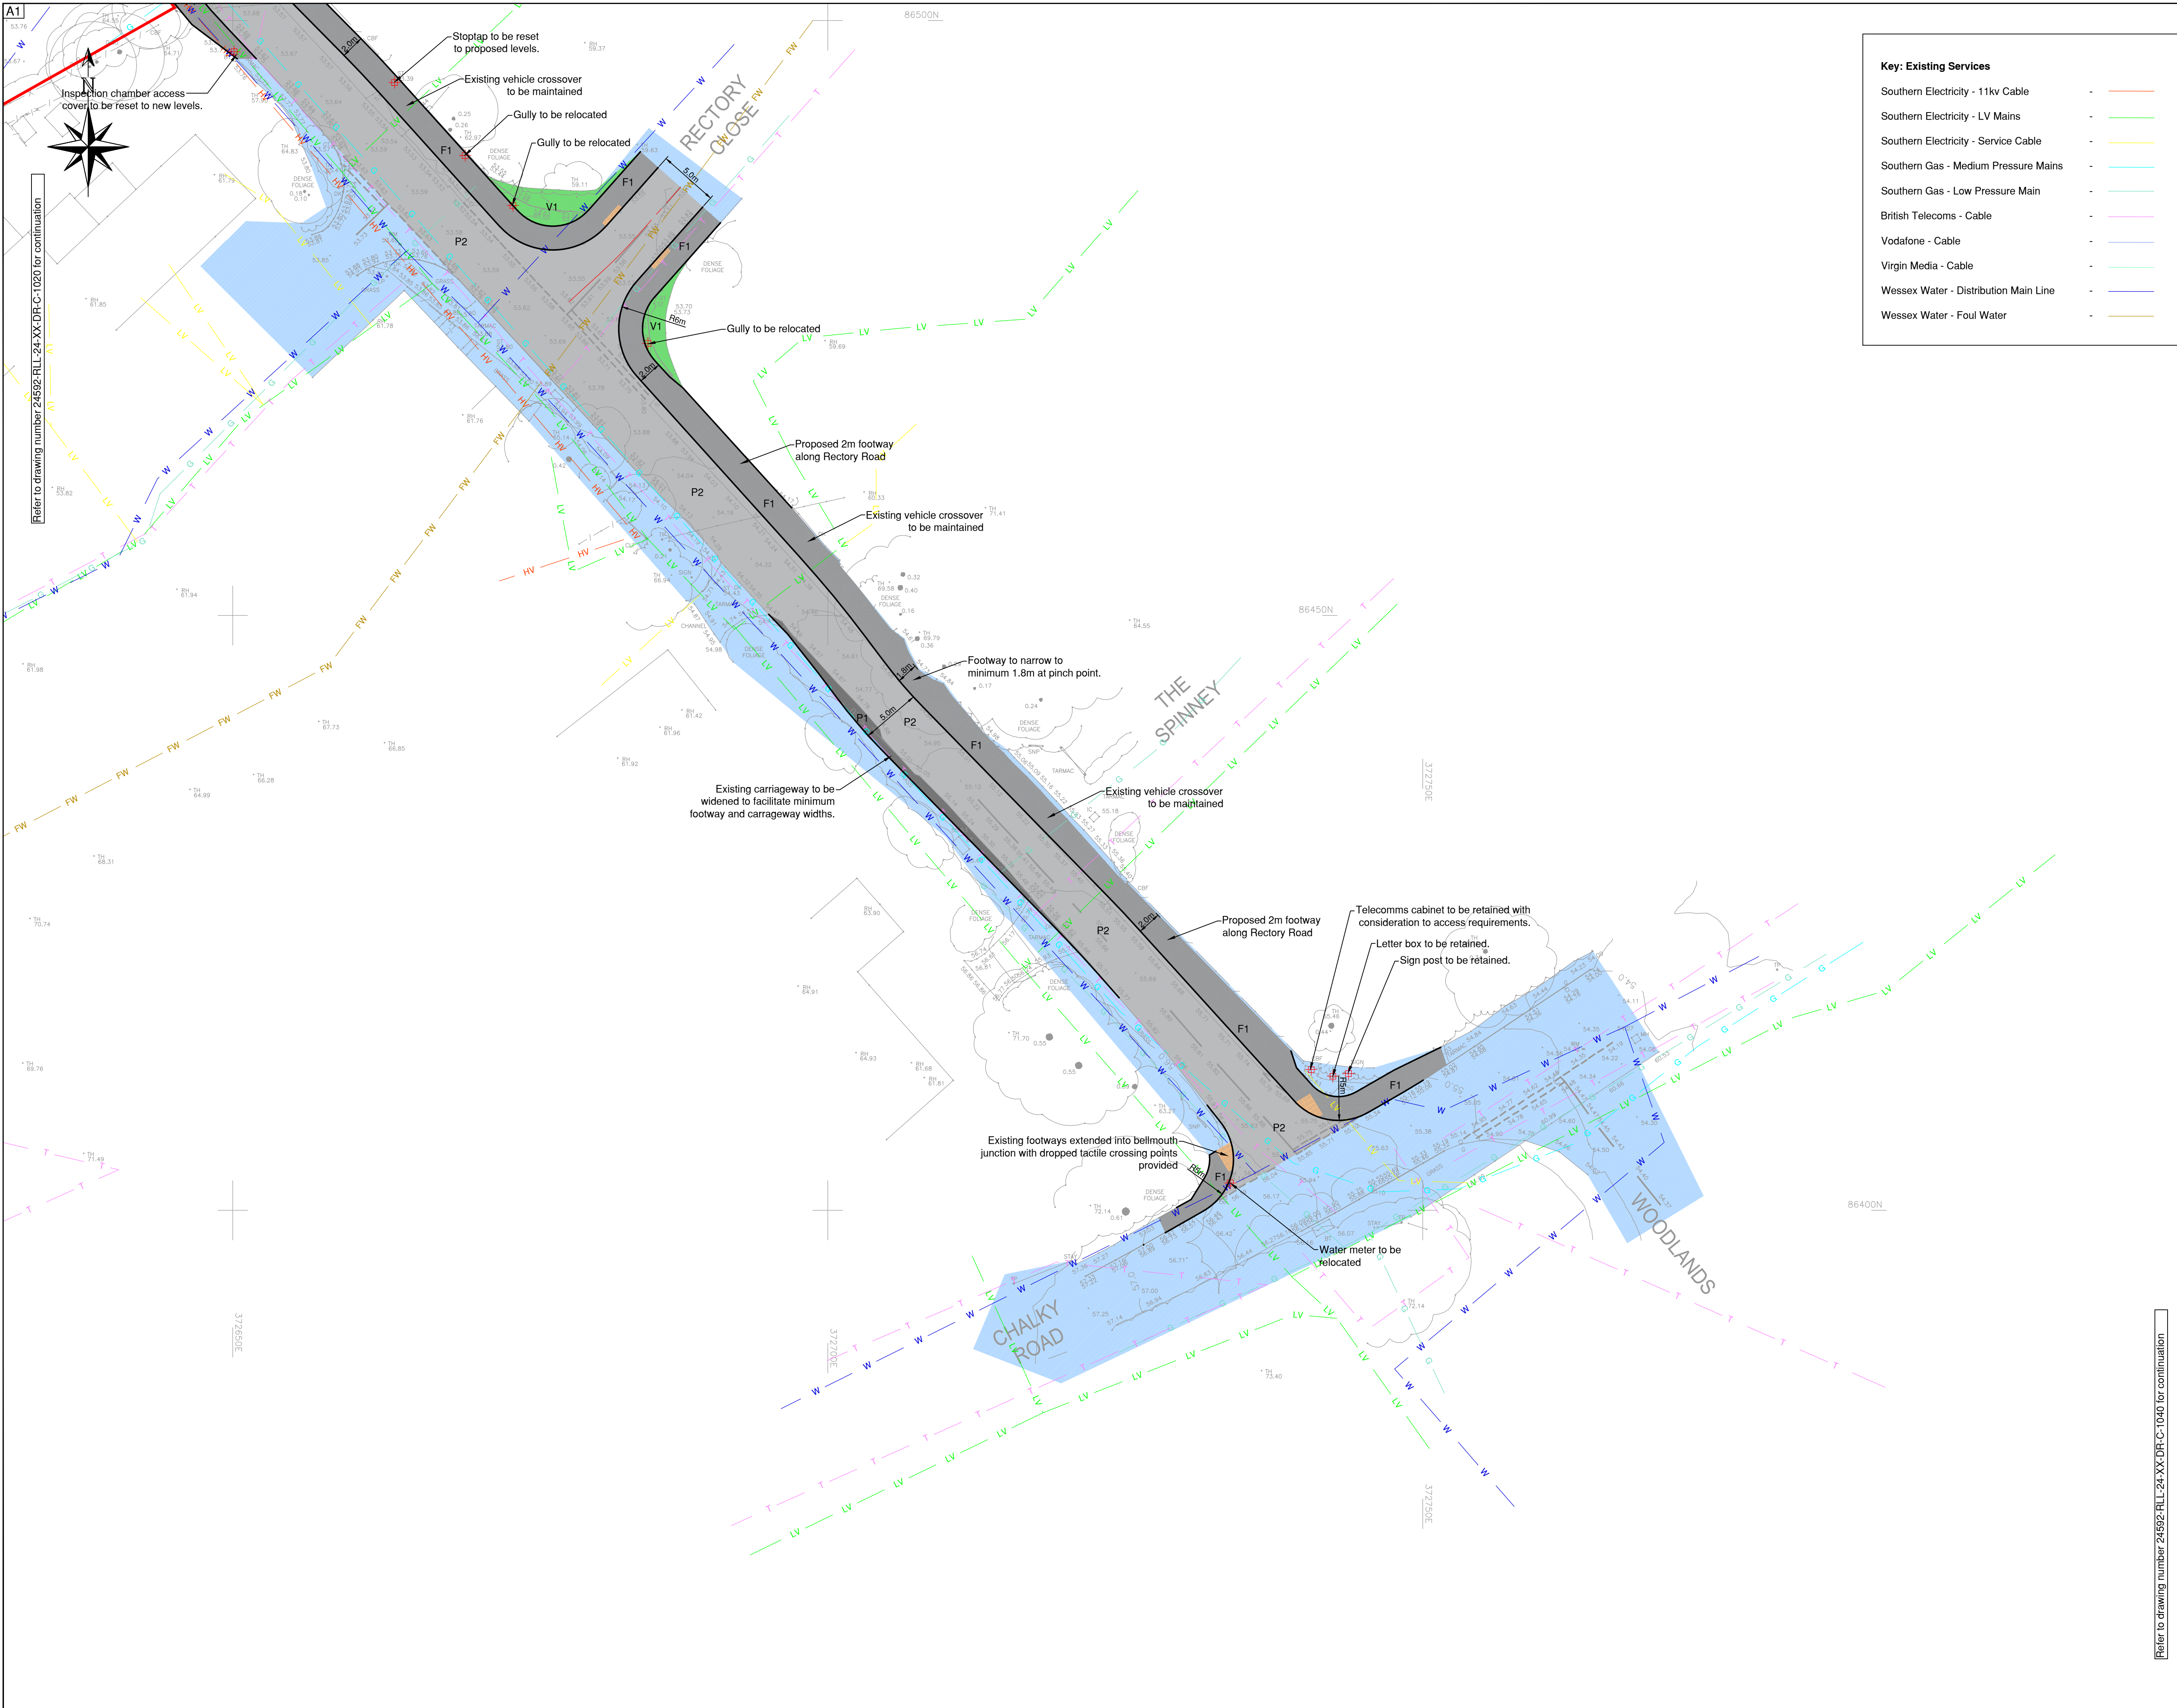

Key: Existing Services

- Southern Electricity - 11kv Cable
- Southern Electricity - LV Mains
- Southern Electricity - Service Cable
- Southern Gas - Medium Pressure Mains
- Southern Gas - Low Pressure Main
- British Telecoms - Cable
- Vodafone - Cable
- Virgin Media - Cable
- Wessex Water - Distribution Main Line
- Wessex Water - Foul Water

GENERAL NOTES

- DO NOT SCALE.
- This drawing is to be read in conjunction with all other relevant drawings and details.
- Should there be any conflict between the details indicated on this drawing and those on other drawings the Engineer should be informed PRIOR to construction on site.
- Until technical approval has been obtained from the relevant Authority, it should be understood that all drawings issued are Preliminary and NOT for construction. Should the Contractor commence site works prior to such approval being provided it is entirely at their own risk.
- All dimensions are in metres unless otherwise stated.
- The Rodgers Leask Designer's Risk Assessment(s) for this project must be reviewed PRIOR to the commencement of any works on site.
- This drawing should be read in conjunction with Section 278 Agreement Works Key Plan 24592-RLL-24-XX-DR-C-1005.
- This drawing is intended to illustrate the extent of S278 works proposed only and does not purport to be a detailed design.

Legend

- Site Boundary
- Assumed existing of public highway
- P1 - Full depth Carriageway
- P2 - Plane and Overlay Carriageway
- F1 - Full Depth Footway
- V1 - Grass Verge
- Features to be relocated or reconstructed
- Tactile Paving Array
- Proposed Kerbline

Health and safety symbols refer to reference numbers indicated on Designers Risk Assessment number: 24592-RLL-24-XX-HS-C-0001

Health & Safety Information Key

- Used to provide design specific safety information that may not be obvious to a competent contractor but may be useful
- Used to restrict/prevent a possible action, e.g. stop construction traffic from entering an area
- Used to warn of significant design hazards, adding recommendations
- Used to encourage a positive action, e.g. use of robust protection for inspection chambers

P01	23.12.24	First Issue	DP	CB
Rev	Date	Amendments	By	Chk



Client
Abri Group


Project
Land adjacent Broadmead Broadmayne, Dorset

Drawing Title
Zone 3 General Arrangement Improvements to Rectory Road/ Chalky Road Junction

Status
For Information

Scale	Drawn	Checked	Date
A1 @ 1:250	DP	CB	23.12.24
Drawing Number			Revision
24592-RLL-24-XX-DR-C-1030			P01

BIM Drawing Reference
-

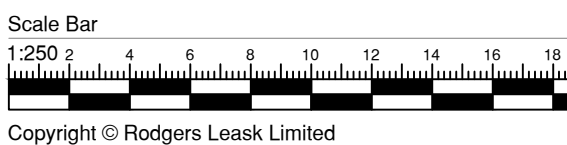

Copyright © Rodgers Leask Limited

A1
Refer to drawing number 24592-RLL-24-XX-DR-C-1020 for continuation

Refer to drawing number 24592-RLL-24-XX-DR-C-1040 for continuation

1/1024 • Woodlands Court • Ash Ridge Road • Alton Barnes • Wiltshire • BA8 9JL • Tel: 01450 879411 • www.rodgersleask.co.uk